

Office of the District Fire Officer  
Karnataka State Fire  
and Emergency Services  
Khanapur Road, Belagavi-590001



Phone : 0831-2429441  
E-Mail : dfobgv@gmail.com

C.NO/102/NOC/DFO/BELAGAVI/2023

Date : 09-05-2023

To,  
The Principal  
Kendriya Vidyalaya School, Chikkodi  
Chikkodi Taluk, Belagavi District.

Sir,

Sub: Issue of '**NOC**' to Kendriya Vidyalaya School, Chikkodi, Chikkodi Taluk, Belagavi District.

Ref: 1) C.NO/139/ADV/CFO/HBI./2021 Date : 04-08-2021.  
2) F.no 7-2/KVCKD/2022-23/1182 Date:23/03/2023.

\*\_\*\_\*\_\*\_\*\_\*\_\*\_\*\_\*\_\*

With reference to the subject above cited, the premises of **Kendriya Vidyalaya School Chikkodi**, building consisting with Basement, Ground and 2 Upper floors situated at Chikkodi Taluk, Belagavi District was inspected by District Fire Officer, Belagavi on 31/03/2023 with respect to fire Prevention, Fire Fighting & Evacuation point of view for the purpose of issuing **NOC** and the details as under.

**ANNEXURE-1**

(Up to 14.99 mtrs. In height)

**"GROUP-B Educational Buildings**

**NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2.**

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory.)

**A. Details of the Building/Premises.**

01.	Name and Address of the Applicant	The Principal Kendriya Vidyalaya School, Chikkodi Chikkodi Taluk, Belagavi District.
02.	Name and Address of the Premises	Kendriya Vidyalaya School, Chikkodi Chikkodi Taluk, Belagavi District.
03.	Name and Address of the Building Owner	The Principal Kendriya Vidyalaya School, Chikkodi Chikkodi Taluk, Belagavi District.
04.	Number of Building	01
05.	Number of Floors	Basement, Ground & 2 Upper floors
06.	<b>Floor-wise details of Occupancy:-</b>	
	Basement Floor	Class rooms-03 no , Computer lab-01 & Library-01.
	Ground Floor	Class rooms-06 nos, Activity room-01, Lab-01, Principal Chamber-01, Office room-01, Head mistress room-01, examination room-01, Ncc/Scouts/Guides room-01, PE room-01, medical room-01.

09/05/23



		Activity room-01, Electrical room-01.
	1 <sup>st</sup> Floor	Class room-11, Lab-01, Art room-01, Social period room-01, Staff room-01.
	2 <sup>nd</sup> Floor	Class room-04, Lab-01, Social room-01, Computer room-01, Maths lab-01, SUPW room-01.
07.	Height of the building	10.80 Mtr
08.	Site area	32.374 Sq mtr
09.	<b>Built-up area of each floor:-</b>	
	Basement floor	742.00 Sq mtr
	Ground Floor	1316.00 Sq mtr
	1 <sup>st</sup> Floor	1316.00 Sq mtr
	2 <sup>nd</sup> Floor	826.00 Sq mtr
10.	Total Built-up area	4200.00 Sq mtr
11.	<b>Surrounding properties:-</b>	
	East	Staff quaters & Farm house
	West	Approach Road
	North	Agriculture Land
	South	Agriculture Land
12.	<b>Open Space all around the building</b>	
	East	04.00 mtr
	West	06.00 mtr
	North	04.00 mtr
	South	03.30 mtr
*Allowed Setbacks ( open space) should be maintained free from further obstruction/construction.		


On the inspection of this School/College premises, the following Fire Prevention, Fire Fighting and Evacuation Measures recommended are considered absolutely essential from fire safety point of view:-

Sl. No (01)	Details (02)	Existing (03)		Recommendations (04)
01.	Accessibility to the premises	The premises is accessible from 05.60 mtr road located on the western side .		Adequate
02.	Number of Entrances	01 entry & 01 exit no. of 05.60 mtr & 04.00 mtr wide.		Adequate
03.	Number of Staircase	No of staircase	01 G-2 <sup>nd</sup> floor & 01 B-G floor.	Complied
		Width of the staircase	02.00      02.00	Adequate
		Width of threads	0.30      0.30	
		Height of risers	0.15      0.15	
		No of risers per flight	12      12	

*Bide*  
09/05/23



		Height of the hand drill.	0.90	0.90	
04.	Portable Extinguishers	12 nos. of 6 Kg capacity ABC type extinguishers and 11 nos. of 4.5 Kg capacity CO2 type extinguisher has been provided. All the extinguishers suggested are BIS markings and are located at an easily accessible position without obstructing the normal passage.			Complied
05.	Hose reel hose system	08 nos. of hose reel hose has been provided. The hose reel hose of min 19 mm size and of 30 mtrs length has been provided to reach the farthest point of each floor and shut off branch having a nozzle of 05 mm size.			Complied
06.	At the terrace tank level with minimum pressure of 3.5 kg/cm2	The system has been connected to booster pump of 450 LPM capacity has been provided. Further the system also has been connected to alternative source of power supply.			Complied
07.	Diesel Generator	01 no.of 15KVA capacity generator has been provided.			Complied
08.	Terrace Tank	RCC overhead tank of 1.5 lakh ltr capacity has been provided.			Adequate
09.	Escape routes	Direction in which the the students/teachers have to move in the event of emergency have been indicated in the corridor/passage as a guide during evacuation .			Complied.
10.	Fire Order (Fire safety plans)	A notice board indicating the action to be taken by the employees in case of any emergency have been displayed along with the telephone numbers of Chikkodi Fire station i.e 08338-27333, 101 & 080-22971550, 22971500, 22971600 the telephone nos nearest ambulance services and police station.			Complied
11.	No Smoking board	COPTA Sec-4 direction of No Smoking area. smoking here is an offence board is written in the English & Kannada both languages and is displayed inside the entry/exit of the each floor.			Complied
12.	Fire Siren	A fire siren has been installed in the premises to inform the students/teachers in case of a fire emergency and evacuate the area.			Complied

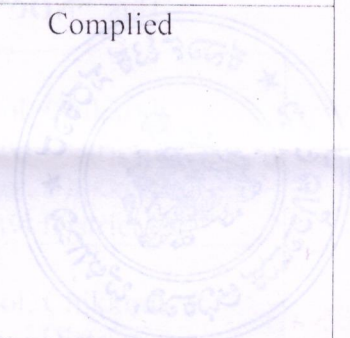

*Handwritten signature and date: 09/05/23*



13.	Nominate One Fire Nodal Officer	Shri Ashitosh.Karado & Ravi Singh has been nominated as fire nodal officers.	Complied
14.	Fire Fighting Training	Not Imparted	At least 40% of the Teaching and non Teaching staff should be got trained in basic fire fighting at R.A.Mundkur Fire & Emergency Services Academy, Bannerughatta Road, Bangalore or Regional training centre.
15.	<u><b>Fire Precautionary Measures</b></u> A :- Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory & electrical sum panel premises. B:- Accumulation of combustibile waste in and around the premises should be avoided. C:- The Exit ways shall be always kept clear without any obstruction. D:- Liquefied petroleum gas should not be stored in the building. E:- The doors shall not be kept locked/ latched during working hours and shall be free from obstruction. F:- During the class hours the class room door shall not be locked from inside to out side. G:- As per Honorable Supreme Court order all teachers and staff shall be trained to handle safety equipments, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14 <sup>th</sup> of every year by conducting Fire Safety drills with co-ordination with the fire services department.		

Under the above circumstance the Karnataka Fire & Emergency Services Department is issuing "NOC" to **Kendriya Vidyalaya School Chikkodi, Chikkodi Taluk, Belagavi District**. As they have complied all the recommendations as per reference 1. The staff should get trained in the basic fire fighting at Training Centre R.A.Mundkur Fire & Emergency Services Academy, Bannerughatta Road, Bangalore or Regional training centre Hubballi.

This "NOC" is valid for only one year from the date of issue and is renewable.

Yours Faithfully

  
District Fire Officer  
Karnataka State Fire And Emergency Services  
Belagavi-01.

